





|  |
|--|
| Jordfeilbryter IDP                                   |
| Antall poler: 4                                      |
| Antall moduler: 4                                    |
| Merkestrøm: 63A                                      |
| Type: A  |
| Utløserstrøm: 300mA                                  |
| Merkespenning: (EN/IEC 61008-1, 61008-2-1) 400/415 V |
| Elnr: 1611801  |

|                                  |   |                                 |   |
|----------------------------------|---|---------------------------------|---|
| Standard;                        | IEC/EN 61009-1,<br>IEC/EN 61009-2-1           | Frekvens (Hz)                   | 50/60 Hz                                      |
| Isolasjonspenning                | 500 V   | Støtstrøm sikker 8/20           | 250A  |
| Nominell impulsstøtspenning      | 4 kV  | Overspennings kategori          | III   |
| Antall inn/utkoblinger elektrisk | ≥ 10 000                                      | Antall inn/utkoblinger mekanisk | ≥ 20 000                                      |
| Tverrsnitt en leder kabel        | ≤1x35 - ≤2x16 -<br>≤1x16+2x10 mm <sup>2</sup> | Tverrsnitt fleksibel kabel      | ≤1x35 - ≤2x16 -<br>≤1x16+2x10 mm <sup>2</sup> |
| Tiltrekningsmoment               | 3Nm   | Driftstemperatur                | -25 til + 60° C                               |
| Lagringstemperatur               | -40 til + 70° C                               | Testknapp test                  | Hver 6 mnd                                    |

#### Dimensjon

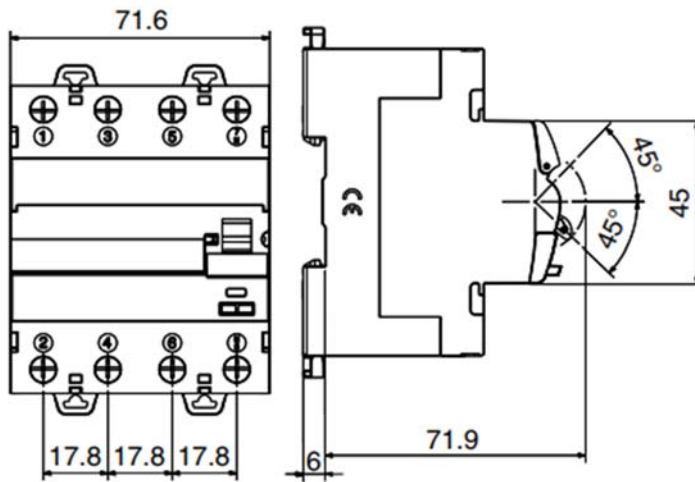

#### Koblings skjema 3 fas IT nett

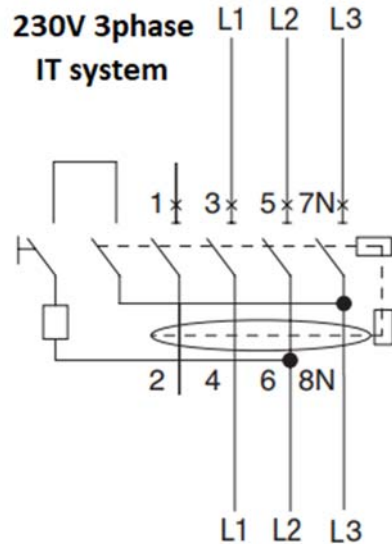

#### Standarder/godkjenninger

